

This Page Is Inserted by IFW Operations
and is not a part of the Official Record

BEST AVAILABLE IMAGES

Defective images within this document are accurate representations of the original documents submitted by the applicant.

Defects in the images may include (but are not limited to):

- BLACK BORDERS
- TEXT CUT OFF AT TOP, BOTTOM OR SIDES
- FADED TEXT
- ILLEGIBLE TEXT
- SKEWED/SLANTED IMAGES
- COLORED PHOTOS
- BLACK OR VERY BLACK AND WHITE DARK PHOTOS
- GRAY SCALE DOCUMENTS

IMAGES ARE BEST AVAILABLE COPY.

**As rescanning documents *will not* correct images,
please do not report the images to the
Image Problem Mailbox.**

PCT

WORLD INTELLECTUAL PROPERTY ORGANIZATION
International Bureau

INTERNATIONAL APPLICATION PUBLISHED UNDER THE PATENT COOPERATION TREATY (PCT)

(51) International Patent Classification 6: C02F 1/32	A1	(11) International Publication Number: WO 96/11879
		(43) International Publication Date: 25 April 1996 (25.04.96)

(21) International Application Number: PCT/CA95/00578

(22) International Filing Date: 16 October 1995 (16.10.95)

(30) Priority Data:
08/323,808 17 October 1994 (17.10.94) US

(71) Applicant (for all designated States except US): TROJAN TECHNOLOGIES INC. [CA/CA]; 3020 Gore Road, London, Ontario N5V 4T7 (CA).

(72) Inventor, and

(75) Inventor/Applicant (for US only): MAARSCHALKER-WEERD, Jan. M. [NL/CA]; 4 Aspen Place, Lambeth, Ontario N6L 1S3 (CA).

(74) Agents: NASSIF, Omar, A. et al.; McCarthy Tétraut, Toronto Dominion Bank Tower, Suite 4700, Toronto-Dominion Centre, Toronto, Ontario M5K 1E6 (CA).


(81) Designated States: AL, AM, AT, AU, BB, BG, BR, BY, CH, CN, CZ, DE, DK, EE, ES, FI, GB, GE, HU, IS, JP, KE, KG, KP, KR, KZ, LK, LR, LT, LU, LV, MD, MG, MN, MW, MX, NO, NZ, PL, PT, RO, RU, SD, SE, SG, SI, SK, TJ, TM, TT, UA, US, UZ, VN, European patent (AT, BE, CH, DE, DK, ES, FR, GB, GR, IE, IT, LU, MC, NL, PT, SE), OAPI patent (BF, BJ, CF, CG, CI, CM, GA, GN, ML, MR, NE, SN, TD, TG), ARIPO patent (KE, MW, SD, SZ, UG).

Published

With international search report.

Before the expiration of the time limit for amending the claims and to be republished in the event of the receipt of amendments.

(54) Title: UV FLUID TREATMENT DEVICE AND METHOD

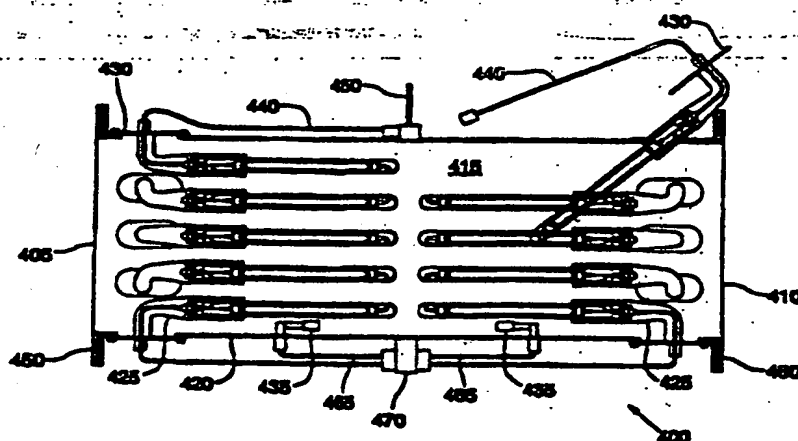

(57) Abstract

A fluid treatment device comprising a housing for receiving a flow of fluid, the housing comprising a fluid inlet, a fluid outlet, a fluid treatment zone disposed between the fluid inlet and the fluid outlet, and at least one radiation source module disposed in the fluid treatment zone, the at least one radiation source module comprising a radiation source sealably connected to a leg, the leg sealably mounted to the housing, the radiation source being disposed substantially parallel to the flow of fluid. A method of treating a fluid in a housing comprising a fluid inlet, a fluid outlet, a fluid treatment zone disposed between the fluid inlet and the fluid outlet, the fluid treatment zone having at least one radiation source disposed therein is also described. The method comprises the steps of: (i) providing a flow of the fluid to the fluid inlet; (ii) feeding the flow of fluid from the fluid inlet to the fluid treatment zone in a manner substantially parallel to the at least one radiation source; (iii) irradiating the flow of fluid in the fluid treatment zone; and (iv) feeding the flow of fluid to the fluid outlet. During the method, the flow of fluid through the fluid inlet, the fluid outlet and the fluid treatment zone is substantially collinear. The fluid treatment device and method are ideally suited (but not limited) to inactivate microorganisms present in water.

FOR THE PURPOSES OF INFORMATION ONLY

Codes used to identify States party to the PCT on the front pages of pamphlets publishing international applications under the PCT.

AT	Austria	GB	United Kingdom	MR	Mauritania
AU	Australia	GE	Georgia	MW	Malawi
BB	Barbados	GN	Guinea	NE	Niger
BE	Belgium	GR	Greece	NL	Netherlands
BF	Burkina Faso	HU	Hungary	NO	Norway
BG	Bulgaria	IE	Ireland	NZ	New Zealand
BJ	Benin	IT	Italy	PL	Poland
BR	Brazil	JP	Japan	PT	Portugal
BY	Belarus	KE	Kenya	RO	Romania
CA	Canada	KG	Kyrgyzstan	RU	Russian Federation
CF	Central African Republic	KP	Democratic People's Republic of Korea	SD	Sudan
CG	Congo	KR	Republic of Korea	SE	Sweden
CH	Switzerland	KZ	Kazakhstan	SI	Slovenia
CI	Côte d'Ivoire	LI	Liechtenstein	SK	Slovakia
CM	Cameroon	LK	Sri Lanka	SN	Senegal
CN	China	LU	Luxembourg	TD	Chad
CS	Czechoslovakia	LV	Latvia	TG	Togo
CZ	Czech Republic	MC	Monaco	TJ	Tajikistan
DE	Germany	MD	Republic of Moldova	TT	Trinidad and Tobago
DK	Denmark	MG	Madagascar	UA	Ukraine
ES	Spain	ML	Mali	US	United States of America
FI	Finland	MN	Mongolia	UZ	Uzbekistan
FR	France			VN	Viet Nam
GA	Gabon				

WO 96/11879

PCT/CA95/00578

-1-

UV FLUID TREATMENT DEVICE AND METHOD

TECHNICAL FIELD

5 In one of its aspects, present invention relates to a fluid treatment device. In another of its aspects, the present invention relates to method for treating a fluid.

BACKGROUND ART

10 Fluid treatment devices and systems are known. For example, United States patents 4,482,809, 4,872,980, 5,006,244 and 5,418,370 (all assigned to the assignee of the present invention), the contents of each of which are hereby incorporated by reference, all describe gravity fed fluid treatment systems which employ ultraviolet (UV) radiation to inactivate microorganisms present in the fluid.

15 The devices and systems described in the '809, '980 and '244 patents generally include several UV lamps each of which are mounted within sleeves extending between two support arms of the frames. The frames are immersed into the fluid to be treated which is then irradiated as required. The amount of radiation to which the fluid is exposed is
20 determined by the proximity of the fluid to the lamps. One or more UV sensors may be employed to monitor the UV output of the lamps and the fluid level is typically controlled, to some extent, downstream of the treatment device by means of level gates or the like. Since, at higher flow rates, accurate fluid level control is difficult to achieve in gravity
25 fed systems, fluctuations in fluid level are inevitable. Such fluctuations could lead to non-uniform irradiation in the treated fluid.

30 However, disadvantages exist with the above-described systems. Depending on the quality of the fluid which is being treated, the sleeves surrounding the UV lamps periodically become fouled with foreign materials, inhibiting their ability to transmit UV radiation to the fluid.

WO 96/11879

PCT/CA95/00578

-3-

DISCLOSURE OF THE INVENTION

It is an object of the present invention to provide a novel fluid treatment device which obviates or mitigates at least one of the disadvantages of the prior art.

5 It is another object of the present invention to provide a novel method for treating a fluid which obviates or mitigates at least one of the disadvantages of the prior art.

Accordingly, in one of its aspects, the present invention provides a fluid treatment device comprising a housing for receiving a flow of fluid, the housing comprising a fluid inlet, a fluid outlet, a fluid treatment zone disposed between the fluid inlet and the fluid outlet, and at least one radiation source module disposed in the fluid treatment zone, the at least one radiation source module comprising a radiation source sealably connected to a leg, the leg sealably mounted to the housing, the radiation source being disposed substantially parallel to the flow of fluid.

10 In another of its aspects, the present invention provides a method of treating a fluid in a housing comprising a fluid inlet, a fluid outlet, a fluid treatment zone disposed between the fluid inlet and the fluid outlet, the fluid treatment zone having at least one radiation source disposed therein, the method comprising the steps of:

- (i) providing a flow of the fluid to the fluid inlet;
 - (ii) feeding the flow of fluid from the fluid inlet to the fluid treatment zone in a manner substantially parallel to the at least one radiation source;
 - 25 (iii) irradiating the flow of fluid in the fluid treatment zone; and
 - (iv) feeding the flow of fluid to the fluid outlet;
- wherein the flow of fluid through the fluid inlet, the fluid outlet and the fluid treatment zone is substantially collinear.

Thus, the present fluid treatment device and method relate to a closed system for treatment of a fluid. As used throughout this

WO 96/11879

PCT/CA95/00578

-4-

specification, the term "closed system", in relation to treatment of a fluid, is intended to encompass a system in which the flow of fluid is pressurized and substantially completely contained in an enclosure throughout treatment. Thus, open, channel-like systems are outside the scope of the present invention since, in the operation of such systems the level of water in the channel and/or treatment zone can vary. The source of pressurization of the flow of fluid is not particularly restricted. For example, the pressure can be generated by a pump or by the action of gravity.

Ideally, the present fluid treatment device and method may be used "in-line" in conventional water piping. Depending on the particular application, the piping can be up to 4 in. diameter for domestic applications, or 1 ft. to 3 ft. diameter or more for municipal applications.

BRIEF DESCRIPTION OF THE DRAWINGS

Embodiments of the present invention will be described with reference to the accompanying drawings, in which:

Figure 1 illustrates, a side elevation, partially cut away, of a conventional closed system for treatment of a fluid;

Figure 2 illustrates an end view of a first embodiment of a fluid treatment device in accordance with the present invention;

Figure 3 illustrates a section along line III-III in Figure 2;

Figure 4 illustrates an end view of a second embodiment of a fluid treatment device in accordance with the present invention;

Figure 5 illustrates a section along line V-V in Figure 4;

Figure 6 illustrates an end view of a third embodiment of a fluid treatment device in accordance with the present invention;

Figure 7 illustrates a section along line VII-VII in Figure 6;

WO 96/11879

PCT/CA95/00578

-6-

between first flange 26 and first plate 28, and second flange 38 and second plate 40, respectively, are achieved is within the purview of a person skilled in the art.

5 In use, inlet flange 16 is connected to a suitable supply pipe (not shown) and outlet flange 20 is connected to a suitable return pipe (not shown). As depicted by arrow A, fluid to be treated enters housing 12 via fluid inlet 14. The fluid is exposed to radiation from UV lamps 22 and exits housing 12 via fluid outlet 18 as depicted by arrow B.

10 The design of fluid treatment device 10 is such that it suffers from significant hydraulic head loss due to the fact that (i) the cross-sectional area of fluid inlet 14 and the fluid outlet 20 of housing 12 is significantly less than that of housing 12, and (ii) the flow of fluid flows a relatively tortuous path. This leads to the creation of dead zones 46, 48 within housing 12 wherein the flow of fluid is negligible resulting in inefficient
15 and, in some cases, non-uniform treatment of fluid.

Accordingly, while the above-described prior art systems have been successful, the present inventor has been concerned with improving fluid treatment devices and systems to overcome some of these disadvantages. The present invention will now be described with
20 reference to the remaining Figures.

With reference to Figures 2 and 3, there is illustrated a fluid treatment system 200 comprising a fluid inlet 205, a fluid outlet 210 and a fluid treatment zone 215 disposed in a housing 220. Disposed in housing 220 are two radiation source modules 225. Each radiation
25 source module 225 is mounted to housing 220 by mounting plate 230 which will be described in more detail hereinbelow. Also disposed in housing 220 are two radiation sensors 235. Emanating from each radiation source module 225 is an electrical lead 240. Each of the electrical leads 240 enters a junction box 245 from which a main
30 electrical conduit 250 emanates. Fluid inlet 205 includes an inlet flange

WO 96/11879

PCT/CA95/00578

-7-

255 and fluid outlet 210 includes an outlet flange 260. Emanating from each radiation sensor is an electrical lead 265. Each of the electrical leads 265 enters a junction box 250 from which a main electrical conduit (not shown) emanates.

- 5 Ideally, fluid treatment system 200 is constructed to be used in-line in existing fluid (e.g. water) piping. Thus, for a given installation, it is desirable to design fluid treatment zone 215 such that it has substantially the same cross-sectional shape and dimension as the existing piping. Inlet flange 255 and outlet flange 260 can be used to
- 10 facilitate installation of fluid treatment system 200 between mating flanges in the existing piping. When the system is installed, it will be apparent to those of skill in the art that fluid flow through fluid treatment zone 215 is parallel with respect to the lamps disposed in radiation source module 225. This minimizes the occurrence of
- 15 hydraulic headloss in the flow of fluid and eliminates dead zones resulting in more efficient treatment of the fluid.

- With reference to Figures 4 and 5, there is illustrated a fluid treatment system 300 comprising a fluid inlet 305, a fluid outlet 310 and a fluid treatment zone 315 disposed in a housing 320. Disposed in
- 20 housing 320 are six radiation source modules 325. Each radiation source module 325 is mounted to housing 320 by a mounting plate 330 which will be described in more detail hereinbelow. Also disposed in housing 320 are two radiation sensors 335. Emanating from each radiation source module 325 is an electrical lead 340. Each of the
- 25 electrical leads 340 enters a junction box 345 from which a main electrical conduit 350 emanates. Fluid inlet 305 includes an inlet flange 350 and fluid outlet 310 includes an outlet flange 360. Emanating from each radiation sensor is an electrical lead 365. Each of the electrical leads 365 enters a junction box 370 from which a main electrical conduit
- 30 (not shown) emanates.

WO 96/11879

PCT/CA95/00578

-8-

With reference to Figures 6 and 7, there is illustrated a fluid treatment system 400 comprising a fluid inlet 405, a fluid outlet 410 and a fluid treatment zone 415 disposed in a housing 420. Disposed in housing 420 are sixteen radiation source modules 425. Each radiation source module 425 is mounted to housing 420 by a mounting plate 430 which will be described in more detail hereinbelow. Also disposed in housing 420 are two radiation sensors 435. Emanating from each radiation source module 425 is an electrical lead 440. Each of the electrical leads 440 enters a junction box 445 from which a main electrical conduit 450 emanates. Fluid inlet 405 includes an inlet flange 450 and fluid outlet 410 includes an outlet flange 460. Emanating from each radiation sensor is an electrical lead 465. Each of the electrical leads 465 enters a junction box 470 from which a main electrical conduit (not shown) emanates.

The construction and use of the fluid treatment systems 300 (Figures 4 and 5) and 400 (Figures 6 and 7) may be effected in the same manner as discussed hereinabove for fluid treatment system 200 (Figures 2 and 3).

With reference to Figures 8 and 9, mounting plate 230 is affixed to housing 220 in the following manner. Initially, it will be apparent that housing 220 comprises a suitably shaped aperture to receive each radiation source module 225. The shape of the aperture is preferably similar to that of mounting plate 230 and the size of the aperture is smaller than that of mounting plate 230. A flange ring 275 sized larger than and having the same shape as the aperture is affixed to housing 220 to define a notch in which a resilient O-ring 280 is placed. Flange ring 275 has a plurality of upstanding bolts (not shown). Mounting plate 230 has a plurality of complementary apertures to receive the bolts on flange ring 275. Mounting plate 230 also contains a backup plate 290 to form, together with flange ring 275, a cavity for O-ring 280. Torque bolts

WO 96/11879

PCT/CA95/00578

-9-

285 are in threaded engagement with each of the upstanding bolts on flange ring 275.

Thus, with reference to Figures 2, 3, 8 and 9, radiation source module is installed in the following manner (see also Figure 7). The end
5 of radiation source module distal mounting plate 230 is inserted in an aperture in housing 220. Mounting plate 230 is then positioned by ensuring that the apertures therein receive the upstanding bolts on flange ring 275. Torque mts 285 are then tightened with sufficient force to compress O-ring 275 thereby providing a hermetic seal between fluid
10 treatment zone 215 and the exterior of housing 220.

With reference to the Figure 10, there is illustrated a detailed view of a radiation source module 225. It will be appreciated by those of skill in the art the radiation source module 225 is similar to radiation source modules 325 (Figures 4 and 5) and 425 (Figures 6 and 7). There
15 is detailed discussion of such a module in copending United States patent application serial number 08/325,949, in the name of the present inventor and filed on even date herewith and hereby incorporated by reference. Thus, radiation source module comprises a support member 115, a radiation source assembly 120 extending from support member
20 115 and mounting plate 230 for affixing radiation source module 225 to housing 220. Mounting plate 230 has a plurality of apertures 232 which receive upstanding bolts from flange ring 275 (Figures 2, 3, 8 and 9).

Radiation source assembly 120 includes a concentric reducer 130 which can be welded to or made integral with support member 115.
25 Affixed to concentric reducer 130 is a ring 135 to which is affixed a mounting sleeve 140. The end of mounting sleeve 140 distal concentric reducer 130 has a threaded portion 145. Disposed within mounting sleeve 140 is an inner sleeve 150 having a threaded portion 145 to which is engaged a cap nut 160. Inner sleeve 150 comprises suitable notches
30 to receive a pair of resilient O-rings 165,170. The end of inner sleeve

WO 96/11879

PCT/CA95/00578

-10-

150 distal concentric reducer 130 abuts a resilient, tapered sealing ring 175. A threaded mounting nut 180 engages threaded portion 155 of mounting sleeve 140 and abuts tapered sealing ring 175. Threaded mounting nut 180 is provided with torquing receptacles 185 which
5 receive a suitable tool useful for torquing mounting nut 180 into sealing engagement with mounting sleeve 140.

Disposed within inner sleeve 150 is an annular piezo-electric ceramic transducer 190 which is a laminate structure made up of a plurality of individual annular piezo-electric ceramic transducers (not
10 shown) adhered together. One end of transducer 90 abuts inner sleeve 150 and the other end of transducer 190 abuts, either directly or indirectly, the open end of a quartz sleeve 195. As illustrated, the opposite end of quartz sleeve 195 is closed. Disposed within quartz sleeve 195 is a radiation source 196. Ideally, the radiation source is an
15 ultraviolet lamp. The ultraviolet lamp is not particularly restricted and the choice thereof is within the purview of a person skill in the art. A pair of spacers 197 are disposed within quartz sleeve 195 and serve to centre and hold in place radiation source 196 within quartz sleeve 195. The electrical connection and control of radiation source 196 is
20 conventional and within the purview of a person skilled in the art.

As described in incorporated copending United States patent application 08/323,808, filed on October 17, 1994, radiation source module 225 is self-cleaning by intermittent or continuous operation of transducer 190 during irradiation of the flow of fluid. More
25 specifically, operation of transducer 190 results in reciprocal vibration of quartz sleeve 195 in a direction substantially parallel to the elongate axis of quartz sleeve 195. Such vibration may be effected by utilizing a piezo-electric transducer, preferably a piezo-electric ceramic transducer. Piezo-electric ceramic transducers have been conventionally
30 used in sonar applications. A suitable piezo-electric ceramic transducer

WO 96/11879

PCT/CA95/00578

-11-

useful in the present radiation source module is commercially available from EDO Corporation (Salt Lake City, Utah) and consists essentially of a ceramic component which meets the specifications of U.S. Navy Type 1 (I) or U.S. Navy Type 3 (III). As will be apparent to those of skill in the art, a ceramic meeting the specifications of U.S. Navy Type 1 is a hard lead zirconate titanate with a Curie point greater than about 310°C and a ceramic meeting the specifications of U.S. Navy Type 3 is a very hard lead zirconate titanate with a Curie point greater than about 290°C. Detailed specifications of these ceramic specifications can be found in published Department of Defense Military Standard DOD-STD 1376A(SH), dated February 28, 1984, the contents of which are hereby incorporated by reference. Generally, the piezo-electric transducer, most preferably an annular piezo-electric transducer, is one which can be operated at a frequency in the range of from about 1 kHz to about 100 kHz, preferably from about 10 kHz to about 20 kHz, more preferably about 10 kHz to about 15 kHz.

Of course it will be appreciated by those of skill in the art that the illustrated embodiments of the radiation source module may be varied to suit the particular fluid treatment system without departing from the spirit of the invention. For example, the number, type and arrangement of sealing rings (i.e. O-rings, tapered rings, etc.) can be varied while maintaining a hermetic seal. Further, the use of in situ means to clean the radiation source module is option. If in situ means to clean the radiation source module is used, it may be a device other than the vibration cleaning device described hereinabove. It should be understood that, while exemplary embodiments of the present invention have been described herein, the present invention is not limited to these exemplary embodiments and that variations and other alternatives may occur to those of skill in the art without departing from the intended spirit and scope of the invention as defined by the attached claims.

WO 96/11879

PCT/CA95/00578

-12-

What is claimed is:

1. A fluid treatment device comprising a housing for receiving a flow of fluid, the housing comprising a fluid inlet, a fluid outlet, a fluid treatment zone disposed between the fluid inlet and the fluid outlet, and at least one radiation source module disposed in the fluid treatment zone, the at least one radiation source module comprising a radiation source sealably connected to a leg, the leg sealably mounted to the housing, the radiation source being disposed substantially parallel to the flow of fluid.

10

2. The fluid treatment device defined in claim 1, wherein the fluid inlet, the fluid outlet and the fluid treatment zone have substantially the same cross-section.

15

3. The fluid treatment device defined in claim 1, wherein the fluid inlet, the fluid outlet and the fluid treatment zone are arranged in a substantially collinear manner.

20

4. The fluid treatment device defined in claim 1, wherein the housing is a substantially elongate cylinder.

5. The fluid treatment device defined in claim 1, wherein the housing has a substantially circular cross-section.

25

6. The fluid treatment device defined in claim 1, wherein the at least one radiation source module comprises at least one ultraviolet lamp.

30

7. The fluid treatment device defined in claim 6, wherein the at least one radiation source module further comprises a sleeve disposed about a portion of the exterior of the at least one ultraviolet lamp.

WO 96/11879

PCT/CA95/00578

-13-

8. The fluid treatment device defined in claim 1, further comprising cleaning means to remove undesired materials from the exterior of the at least one radiation source module.
- 5 9. The fluid treatment device defined in claim 1, further comprising means to monitor the level of radiation being emitted from the radiation source.
-
- 10 10. The fluid treatment device defined in claim 1, wherein the leg comprises a conduit for carrying electrical connection means to the radiation source.
11. The fluid treatment device defined in claim 1, wherein the end of the leg distal the radiation source comprises a mounting plate sealably
15 connected to the housing.
12. The fluid treatment device defined in claim 1, comprising a plurality of radiation source modules mounted circumferentially to the housing to define a radiation source ring.
- 20 13. The fluid treatment device defined in claim 12, wherein the radiation source modules are arranged substantially equidistant to one another.
- 25 14. The fluid treatment device defined in claim 12, comprising two or more radiation source rings.
15. A method of treating a fluid in a housing comprising a fluid inlet, a fluid outlet, a fluid treatment zone disposed between the fluid inlet and

WO 96/11879

PCT/CA95/00578

-14-

the fluid outlet, the fluid treatment zone having at least one radiation source disposed therein, the method comprising the steps of:

- (i) providing a flow of the fluid to the fluid inlet;
- (ii) feeding the flow of fluid from the fluid inlet to the fluid treatment zone in a manner substantially parallel to the at least one radiation source;
- (iii) irradiating the flow of fluid in the fluid treatment zone; and
- (iv) feeding the flow of fluid to the fluid outlet;

wherein the flow of fluid through the fluid inlet, the fluid outlet and the fluid treatment zone is substantially collinear.

16. The method defined in claim 15, comprising the further step of selecting the fluid inlet, the fluid outlet and the fluid treatment zone having substantially the same cross-section.

17. The method defined in claim 15, wherein the housing is a substantially elongate cylinder.

18. The method defined in claim 15, wherein the housing has a substantially circular cross-section.

19. The method defined in claim 15, wherein the at least one radiation source module comprises at least one ultraviolet lamp.

20. The method defined in claim 19, wherein the at least one radiation source module further comprises a sleeve about a portion of the exterior of the at least one ultraviolet lamp.

WO 96/11879

PCT/CA95/00578

-15-

21. The method defined in claim 22, comprising the further step of removing undesired materials from the exterior of the at least one radiation source assembly.

5 22. The method defined in claim 15, comprising the further step of monitoring the level of radiation being emitted from the radiation source.

10 23. The fluid treatment device defined in claim 7, further comprising vibration generation means in contact with the sleeve, the vibration generation means capable of effecting reciprocal vibration of the sleeve to remove undesired materials from the sleeve.

24. The fluid treatment device defined in claim 23, wherein the vibration generation means is a piezo-electric transducer.

15

25. The fluid treatment device defined in claim 24, wherein the piezo-electric transducer has an operating frequency of from about 1 kHz to about 100 kHz.

20 26. The fluid treatment device defined in claim 24, wherein the piezo-electric transducer has an operating frequency of from about 10 kHz to about 20 kHz.


25 27. The method defined in claim 15, wherein reciprocal vibration is conducted at a frequency of from about 1 kHz to about 100 kHz.

28. The method defined in claim 15, wherein reciprocal vibration is conducted at a frequency of from about 10 kHz to about 20 kHz.

30 29. The method defined in claim 15, wherein the fluid is water.

WO 96/11879

PCT/CA95/00578

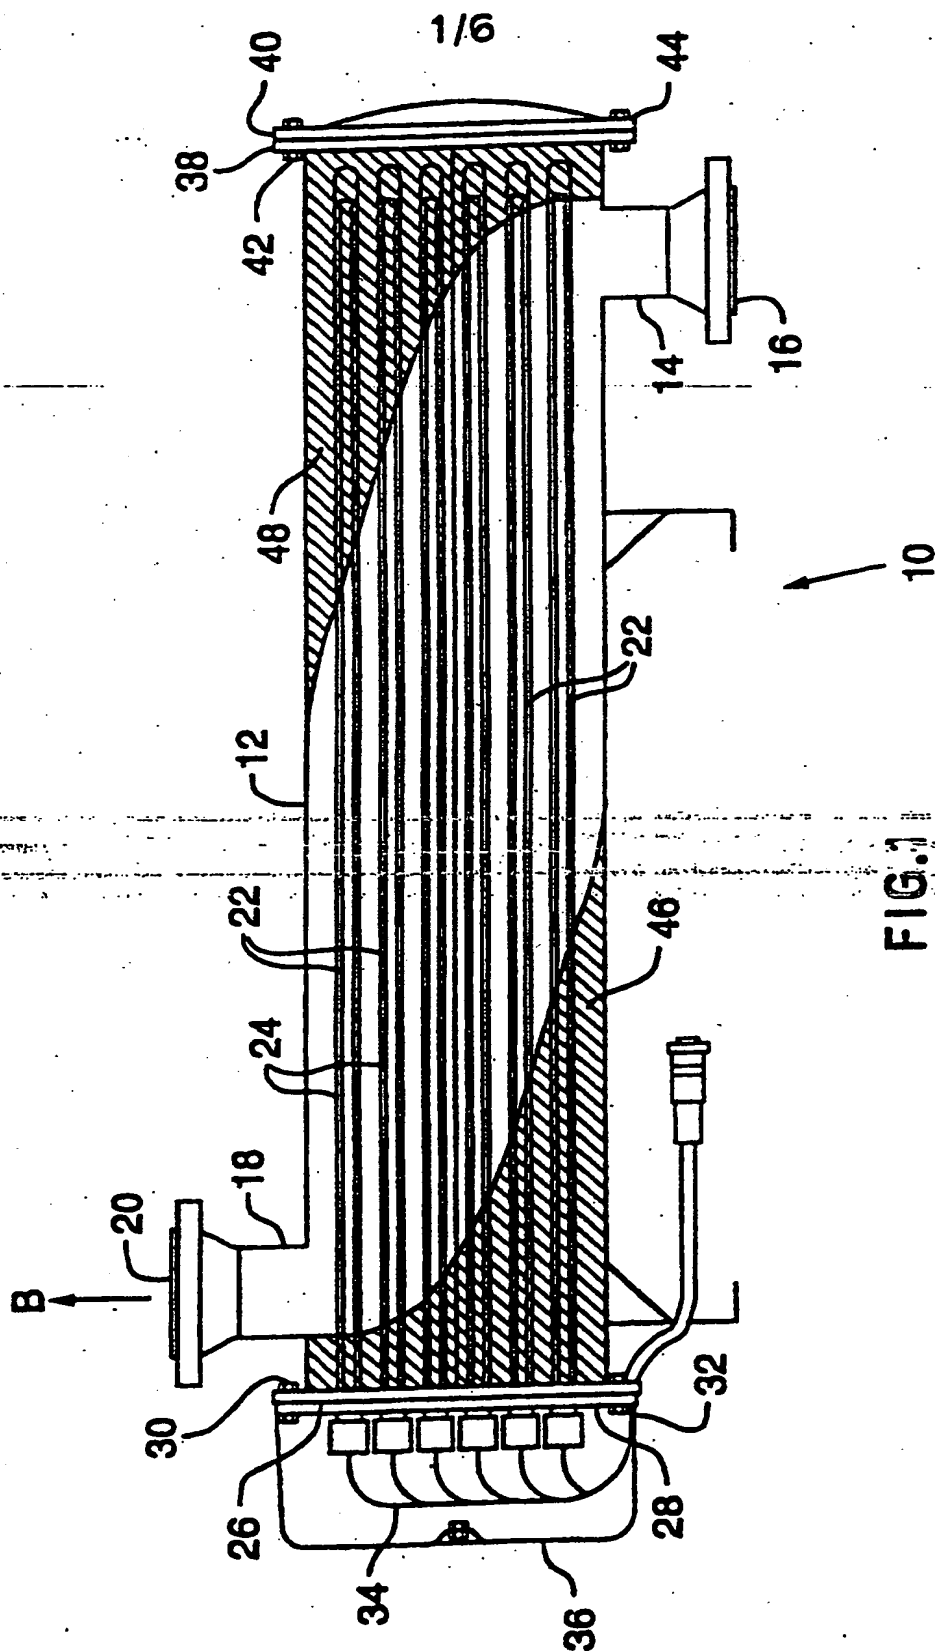

WO 96/11879

PCT/CA95/00578

2/6

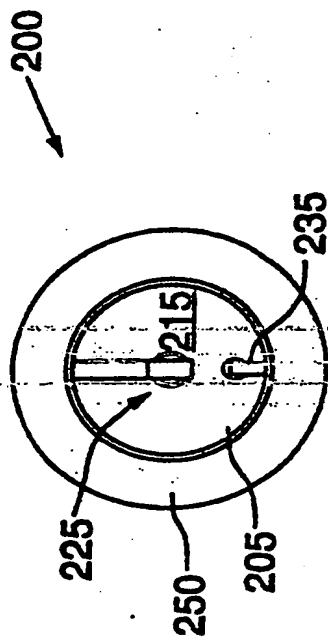


FIG. 2



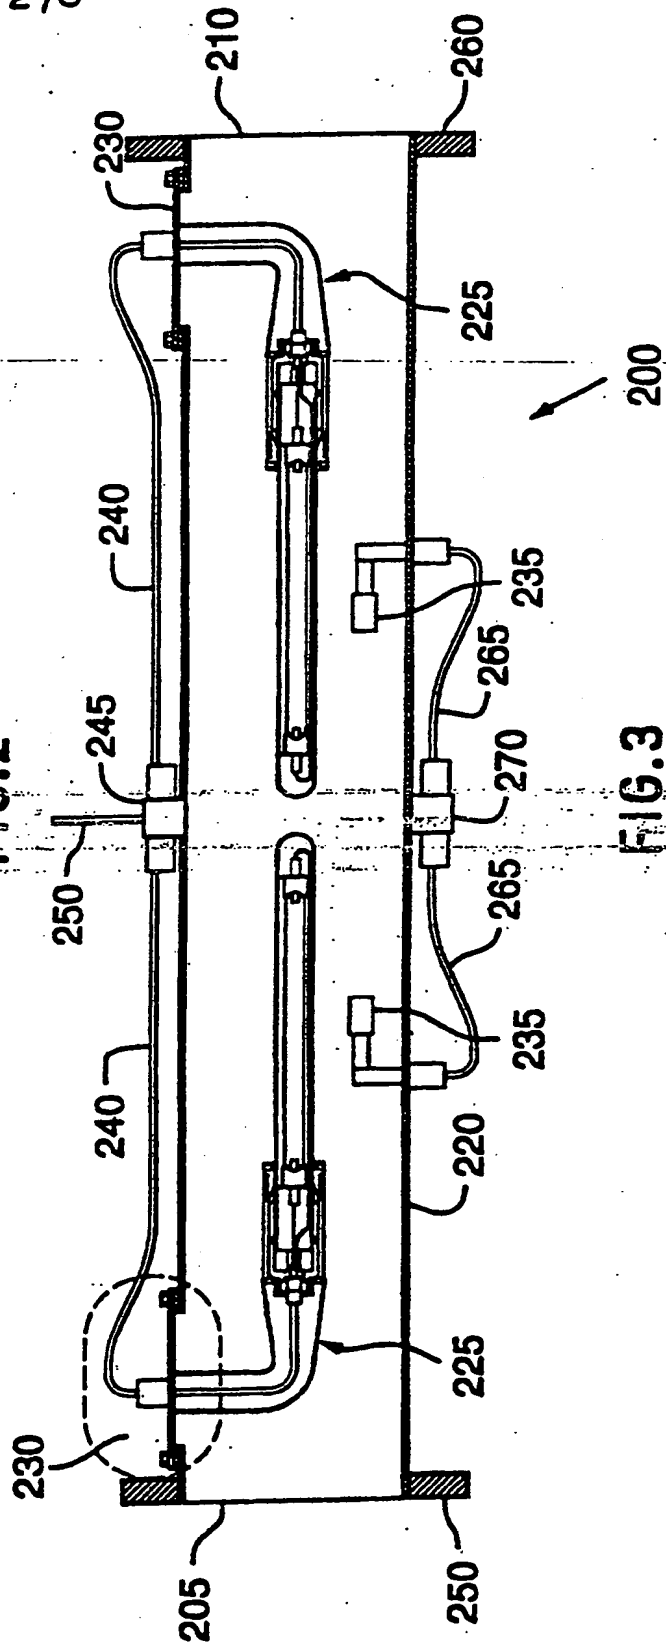


FIG. 3

WO 96/11879




PCT/CA95/00578

3 / 6

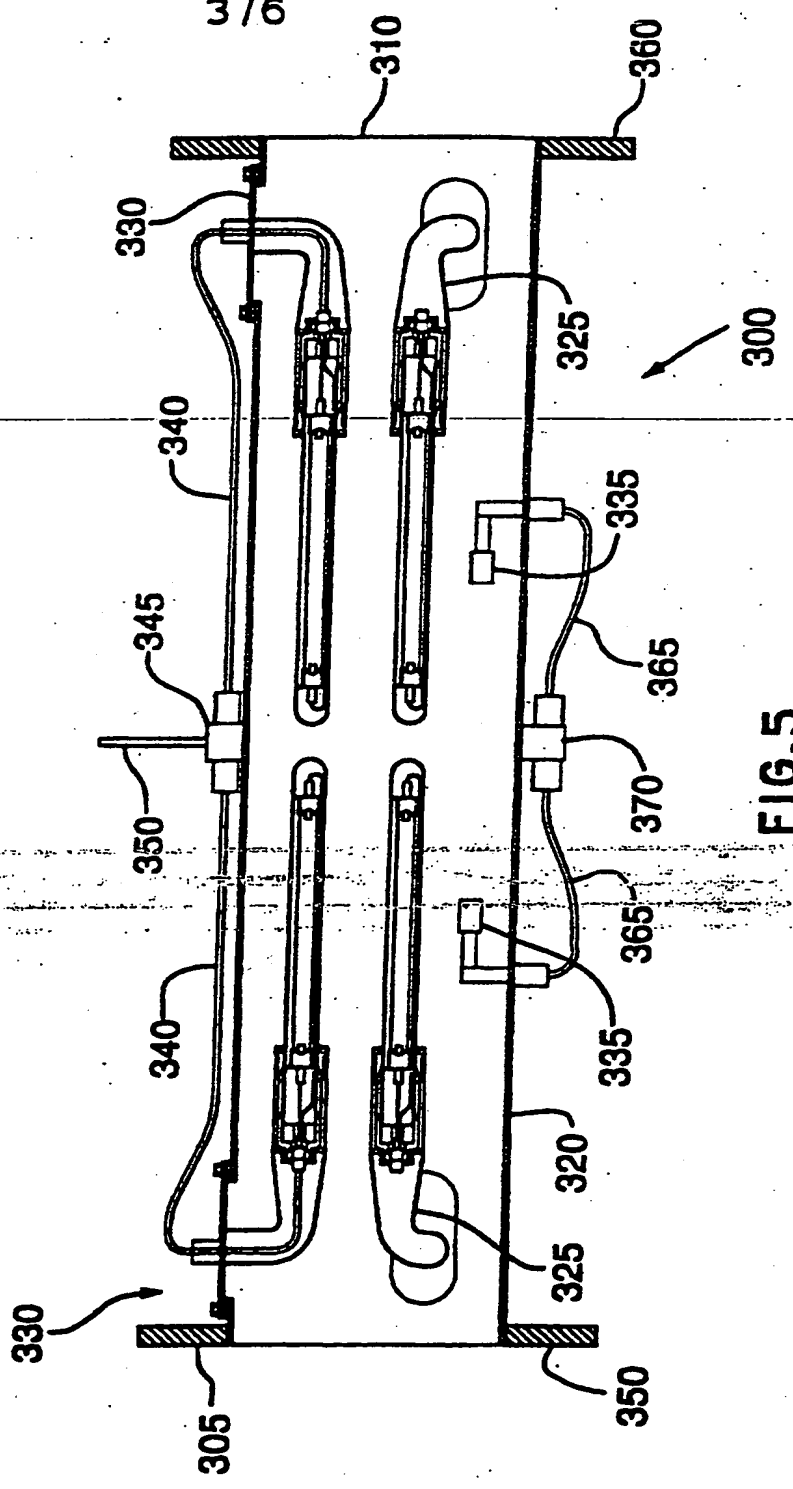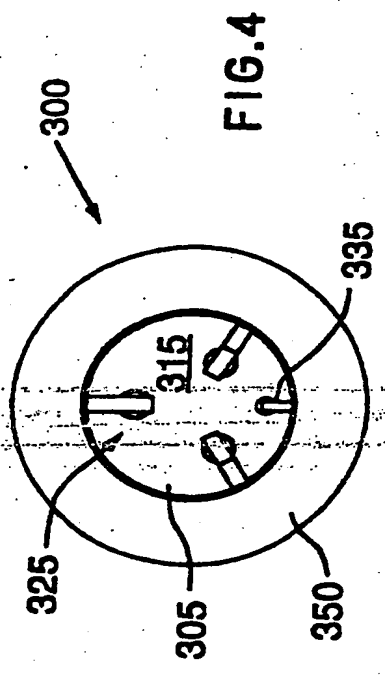

WO 96/11879

PCT/CA95/00578

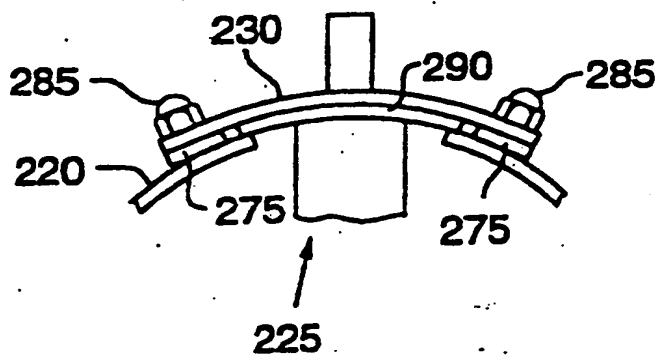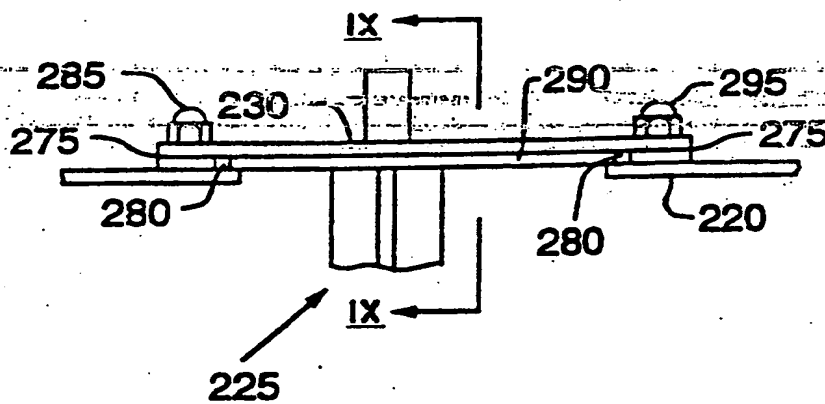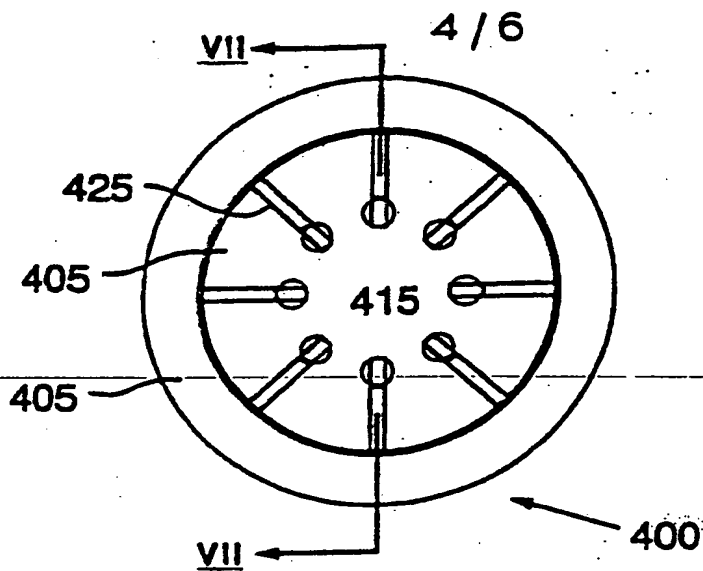

WO 96/11879

PCT/CA95/00578

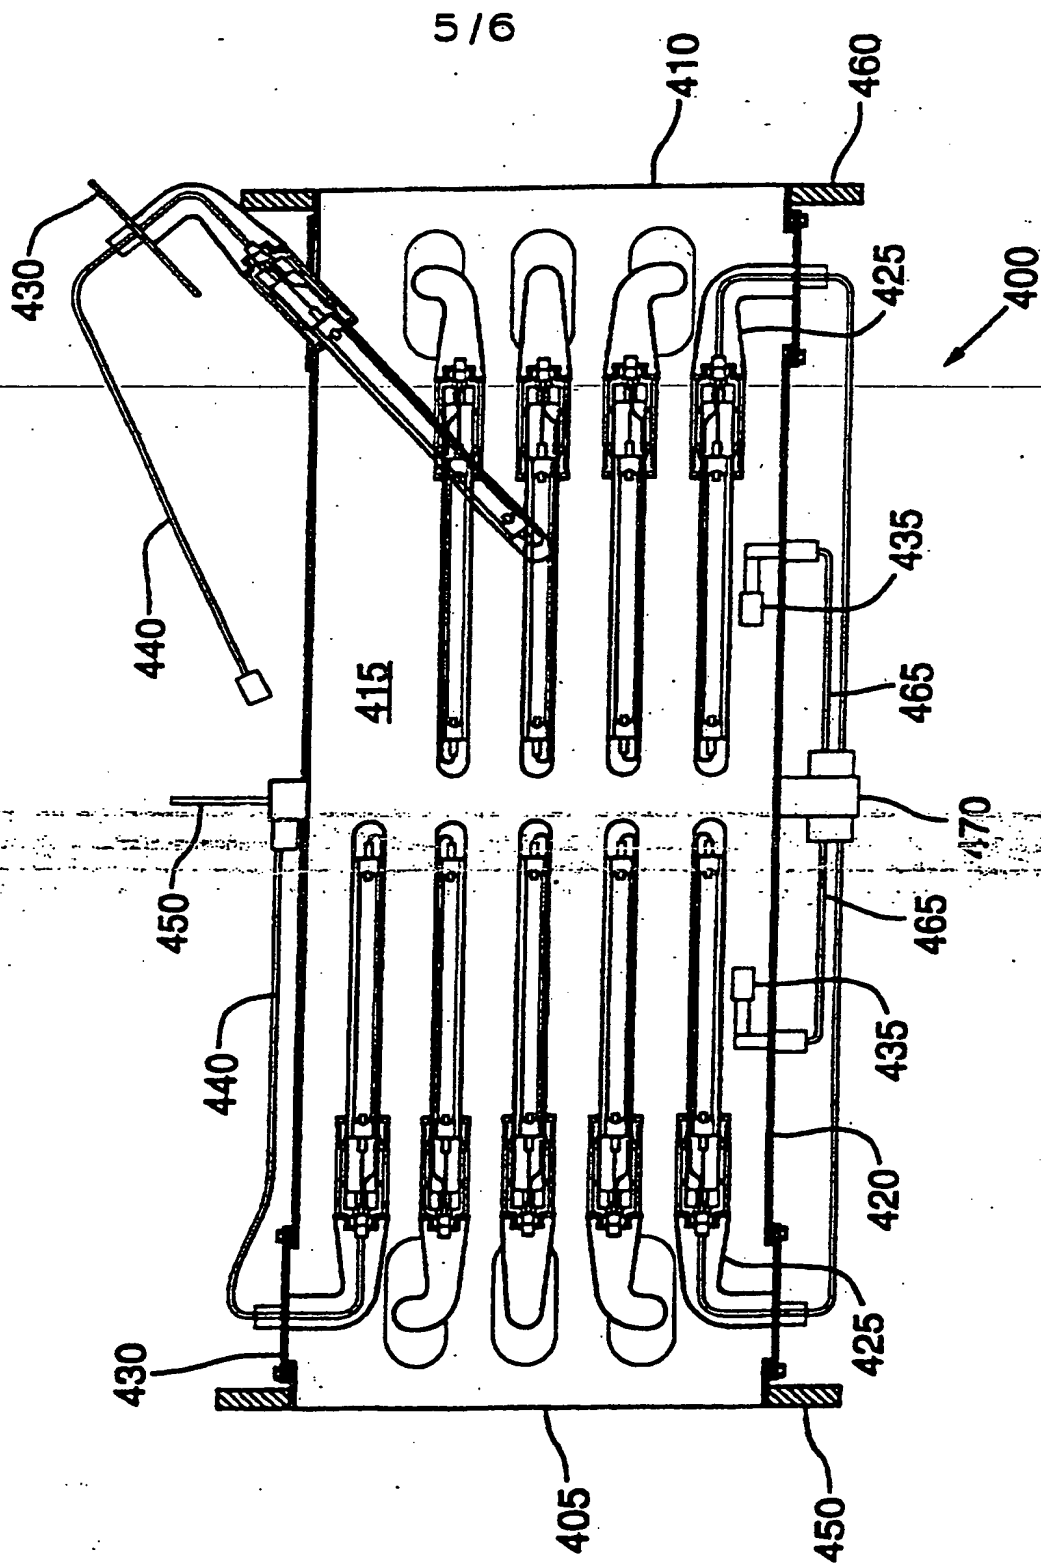


FIG. 7

WO 96/11879

PCT/CA95/00578

6 / 6

